

ABN 82 064 651 083

Legend

- LV Cable
- Conduit
- Drawing Boundary
- HV Cable
- Asbestos Conduit
- Zone Sub. / Terminal Station
- Subtransmission Cable
- DBYD Search Area
- Fibre Optic / Auxiliary Cable
- Connection

- LV / Lighting Pole
- LV / Subtrans. Pole
- LV / HV / Subtrans. Pole
- HV Pole
- HV / Subtrans. Pole
- Subtrans. Pole



Scale: 1:1000

Issue Date: 05/06/2024


DBYD Seq. No: 240175234

DBYD Job No: 36840413

Tile No: 1

WARNING: This is a representation of Jemena Electricity Networks underground assets only and may not indicate all assets in the area. It must not be used for the purpose of exact asset location in order to undertake any type of excavation. Please read all conditions and information on the attached information sheet. This extract is subject to those conditions. The information contained on this plan is only valid for 28 days from the Date of Issue.

Sewer

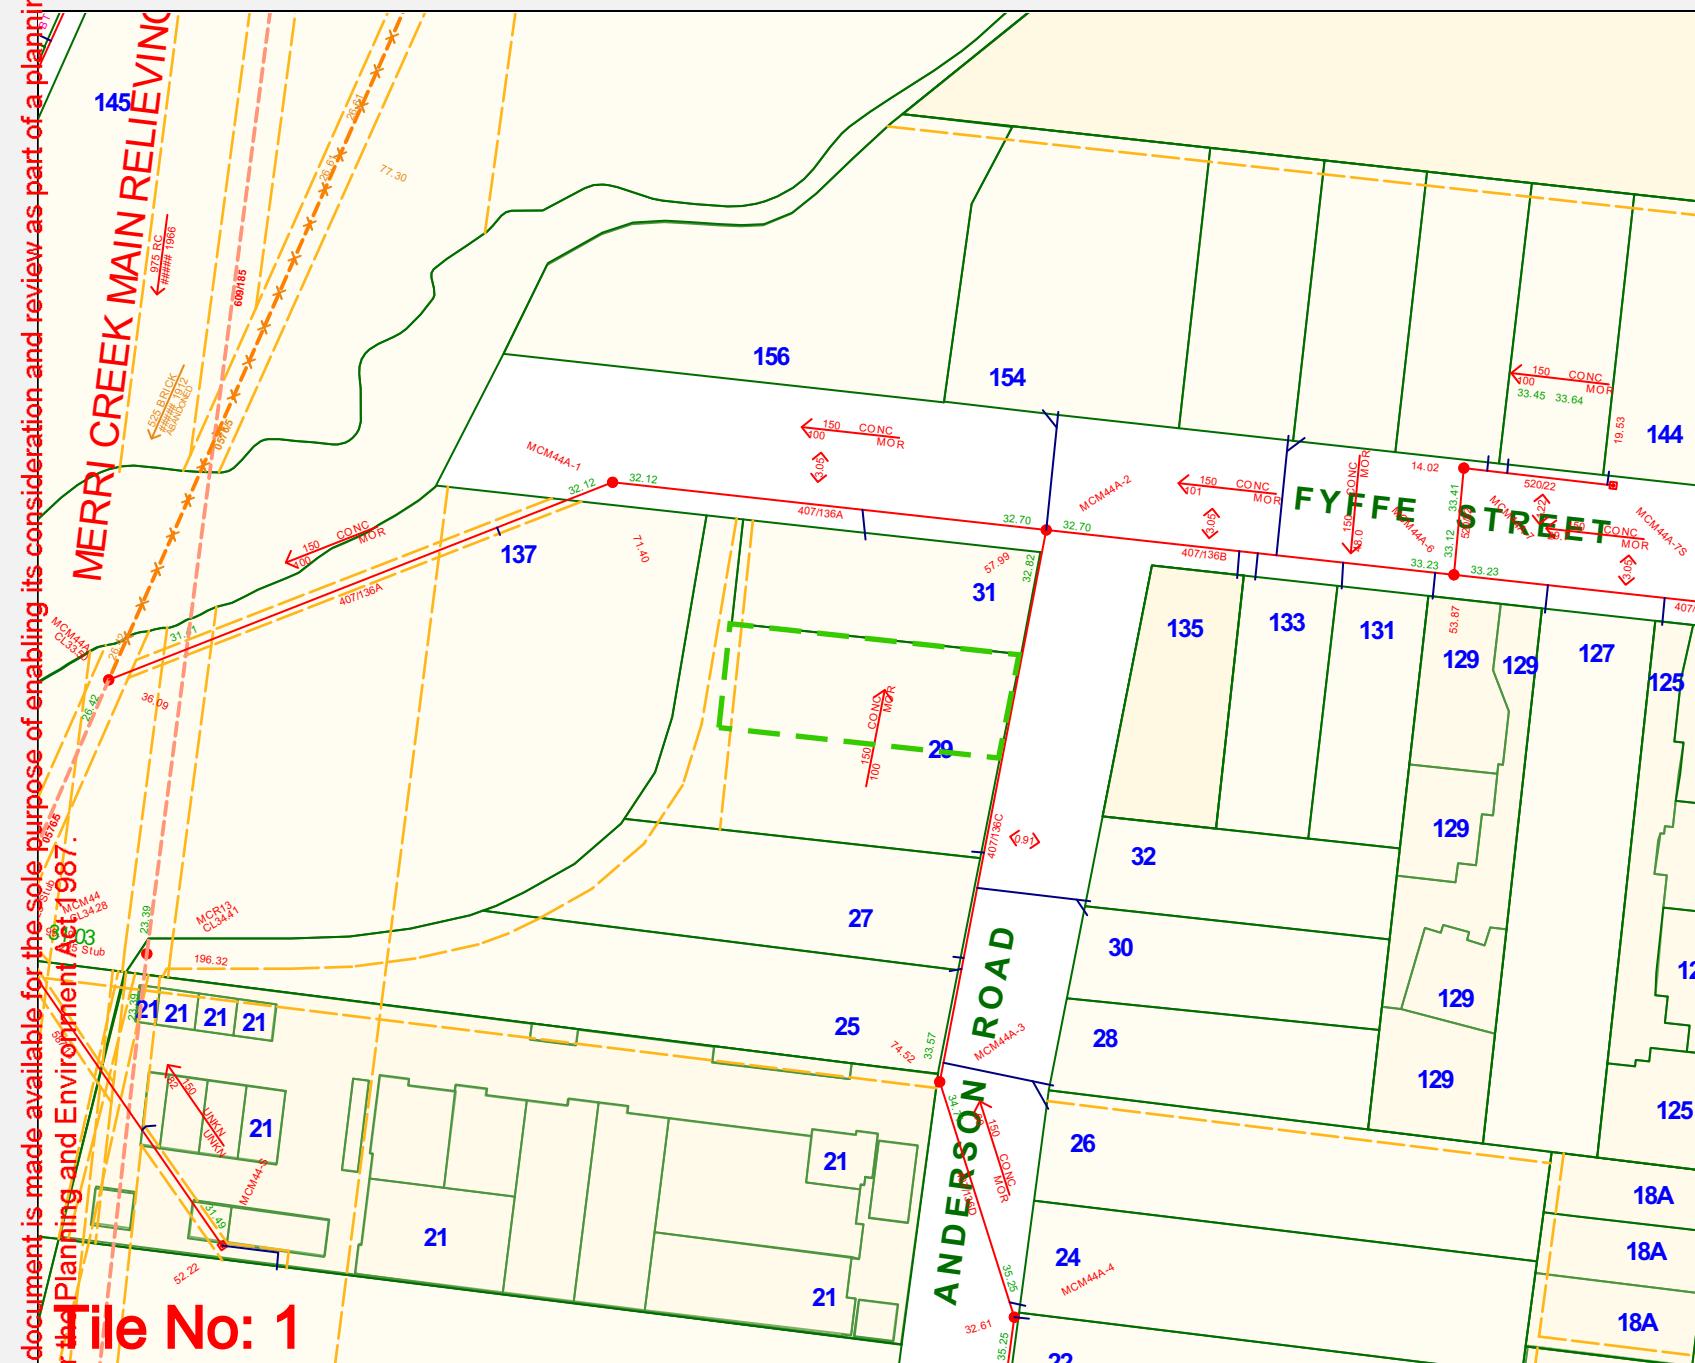

Water

Darebin City Council Received 5-06-2024

FYFFE STREET

6mm F.S.
3.1~
F.S.
50m
ANDERSON ROAD

125PE
3/08/2018

1

100

1

4.

1

1

40413
nderson

175237


Legend

Existing Title	
Proposed Title	
Offset Water Main	 3.0
Water Main	 150PVC-M 08/11/2013
Water Reticulation Main	
Asbestos Water Main	
Blank End	
Water Valve	
Dialysis Patient	 <i>Dialysis</i>
	<u>YVW / Counc</u>
Hydrant Below Ground	 
Hydrant Above Ground	 

Warning – This plan is issued solely for the purpose of assisting you in identifying Yarra Valley Water's specified assets through further investigation only. It's not to be used for any other purpose, including to identify any other assets, property boundaries or dimensions. Accordingly, the location of all assets should be proven by hand on site prior to the commencement of any work. Please refer to the attached letter for further


N Scale: 1:1000
Expires: 03 Jul 2024

DISCLAIMER: While reasonable measures have been taken to ensure the accuracy of the information contained in this plan response, neither Yarra Valley Water nor PelicanCorp shall have any liability whatsoever in relation to any loss, damage, cost or expense arising from the use of this plan response or the information contained in it or the completeness or accuracy of such information. Use of such information is subject to and constitutes acceptance of these terms.

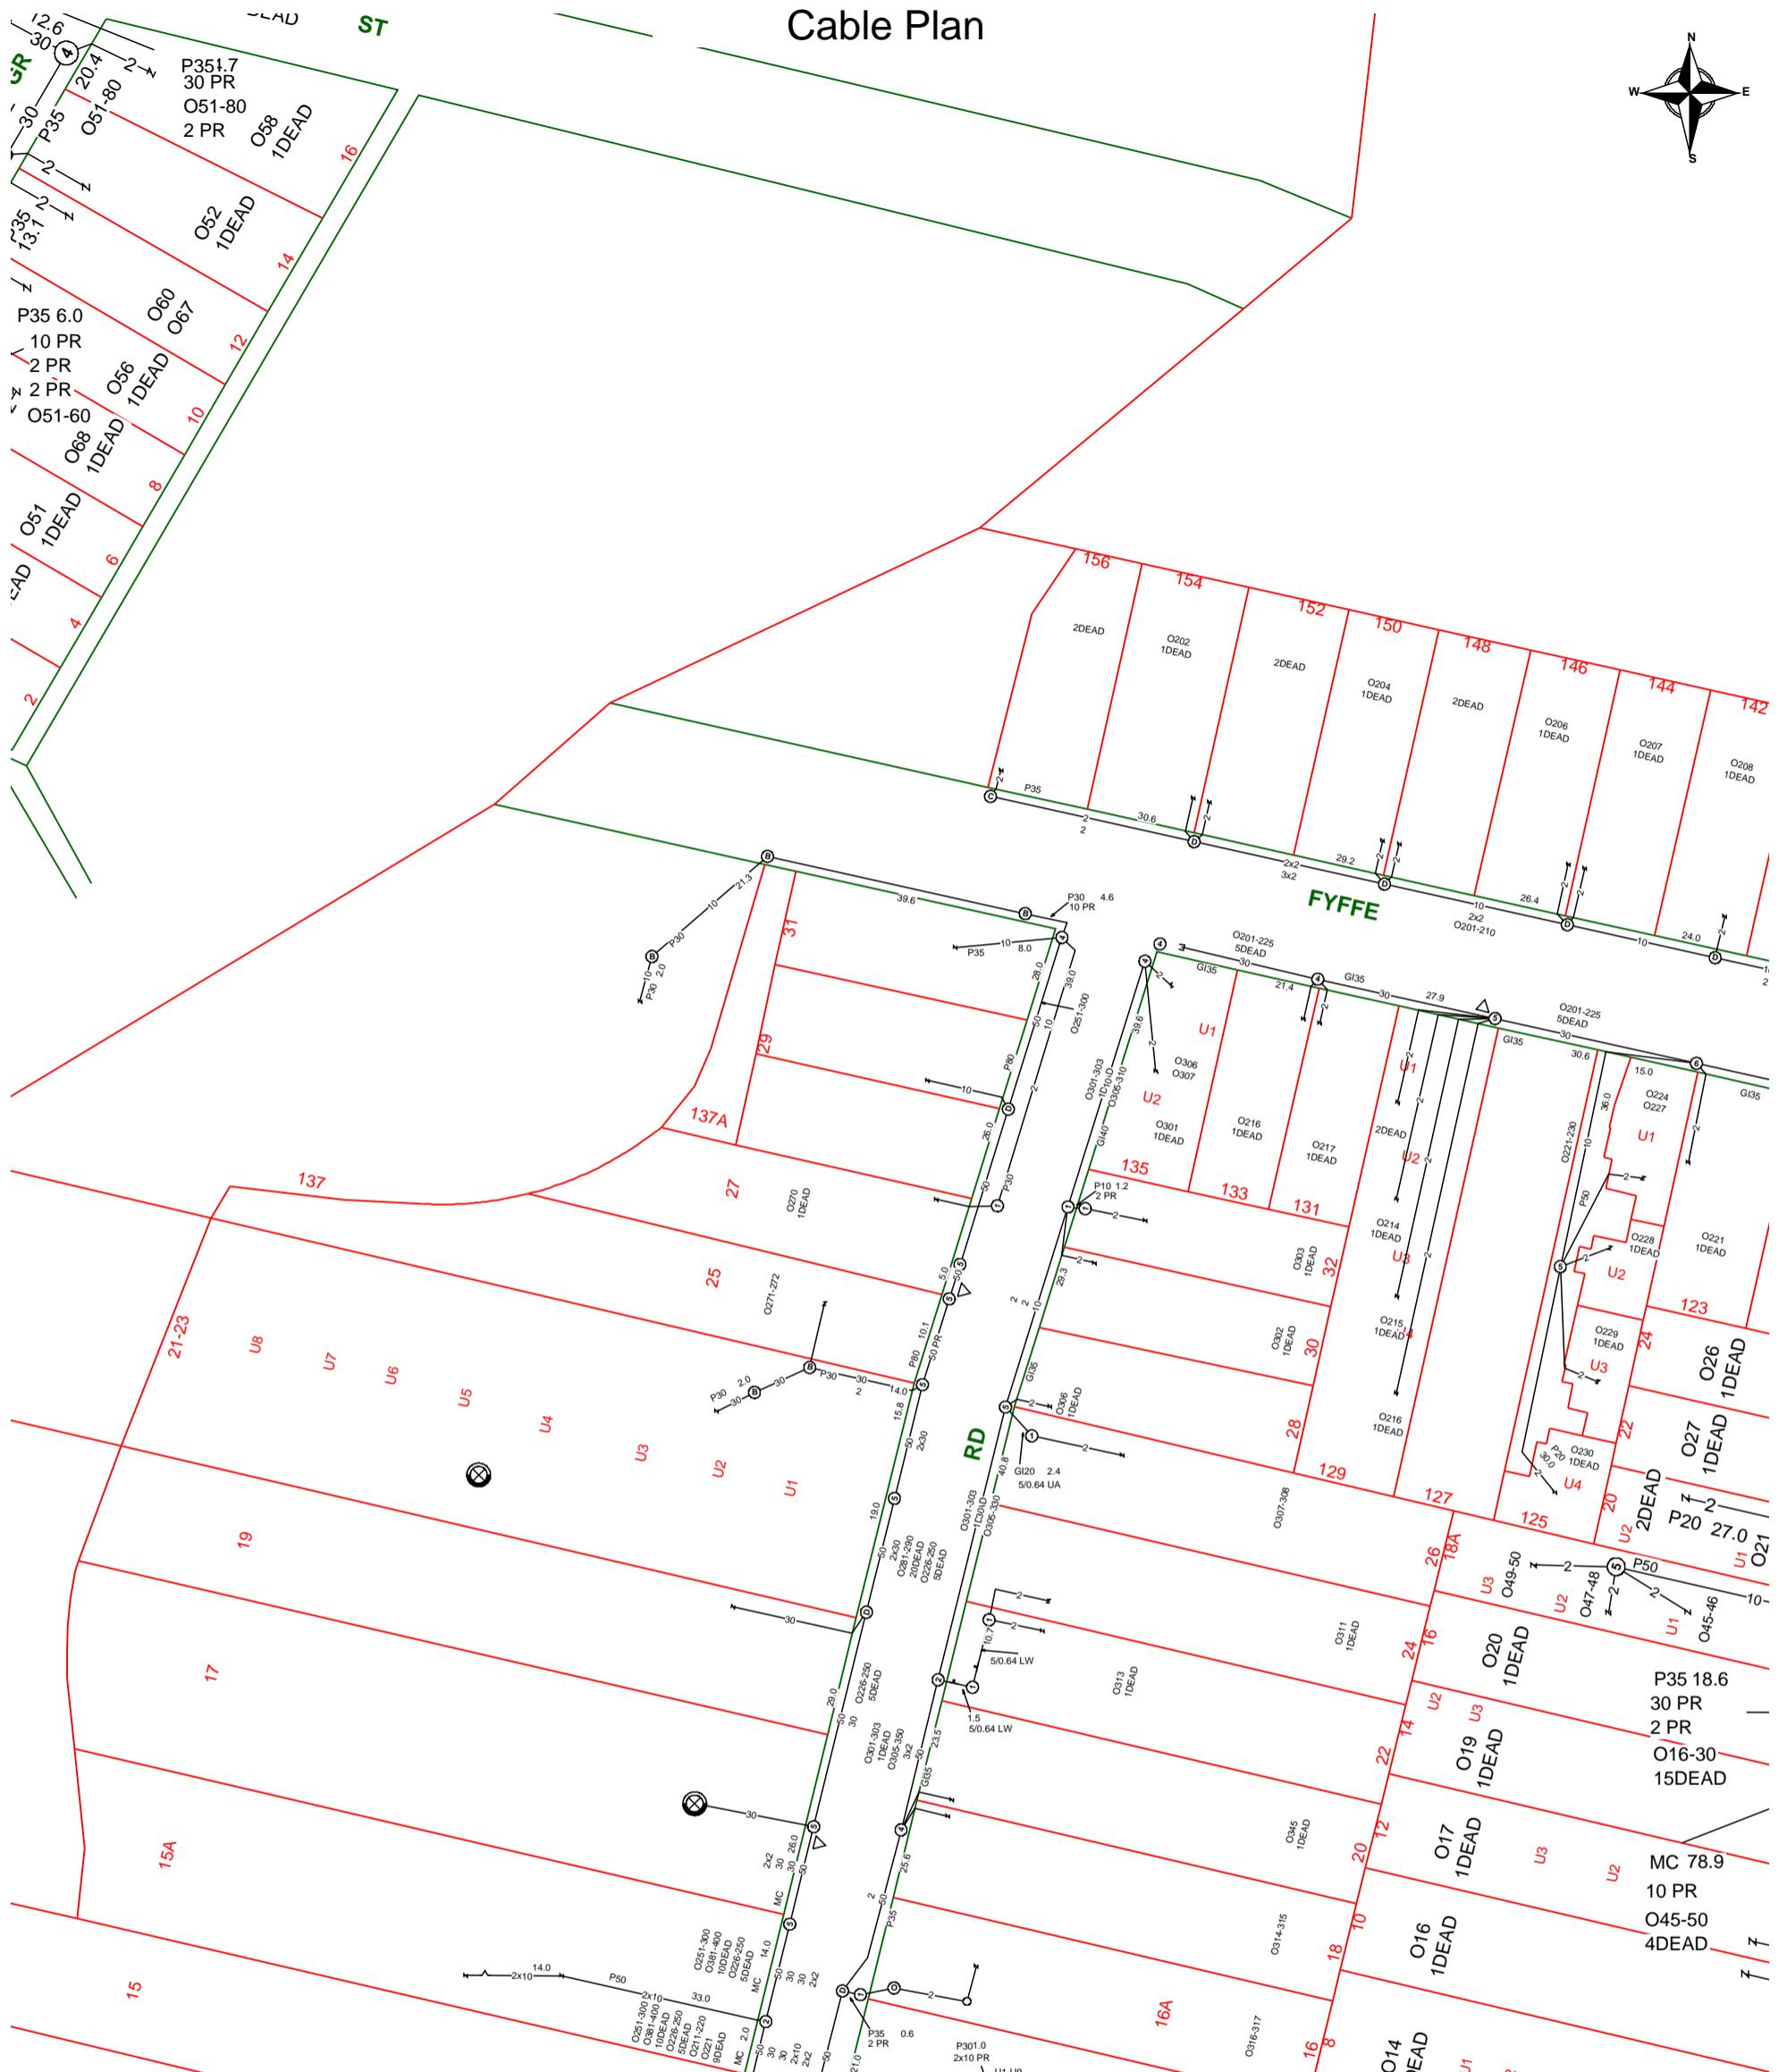



Mains Cable Plan

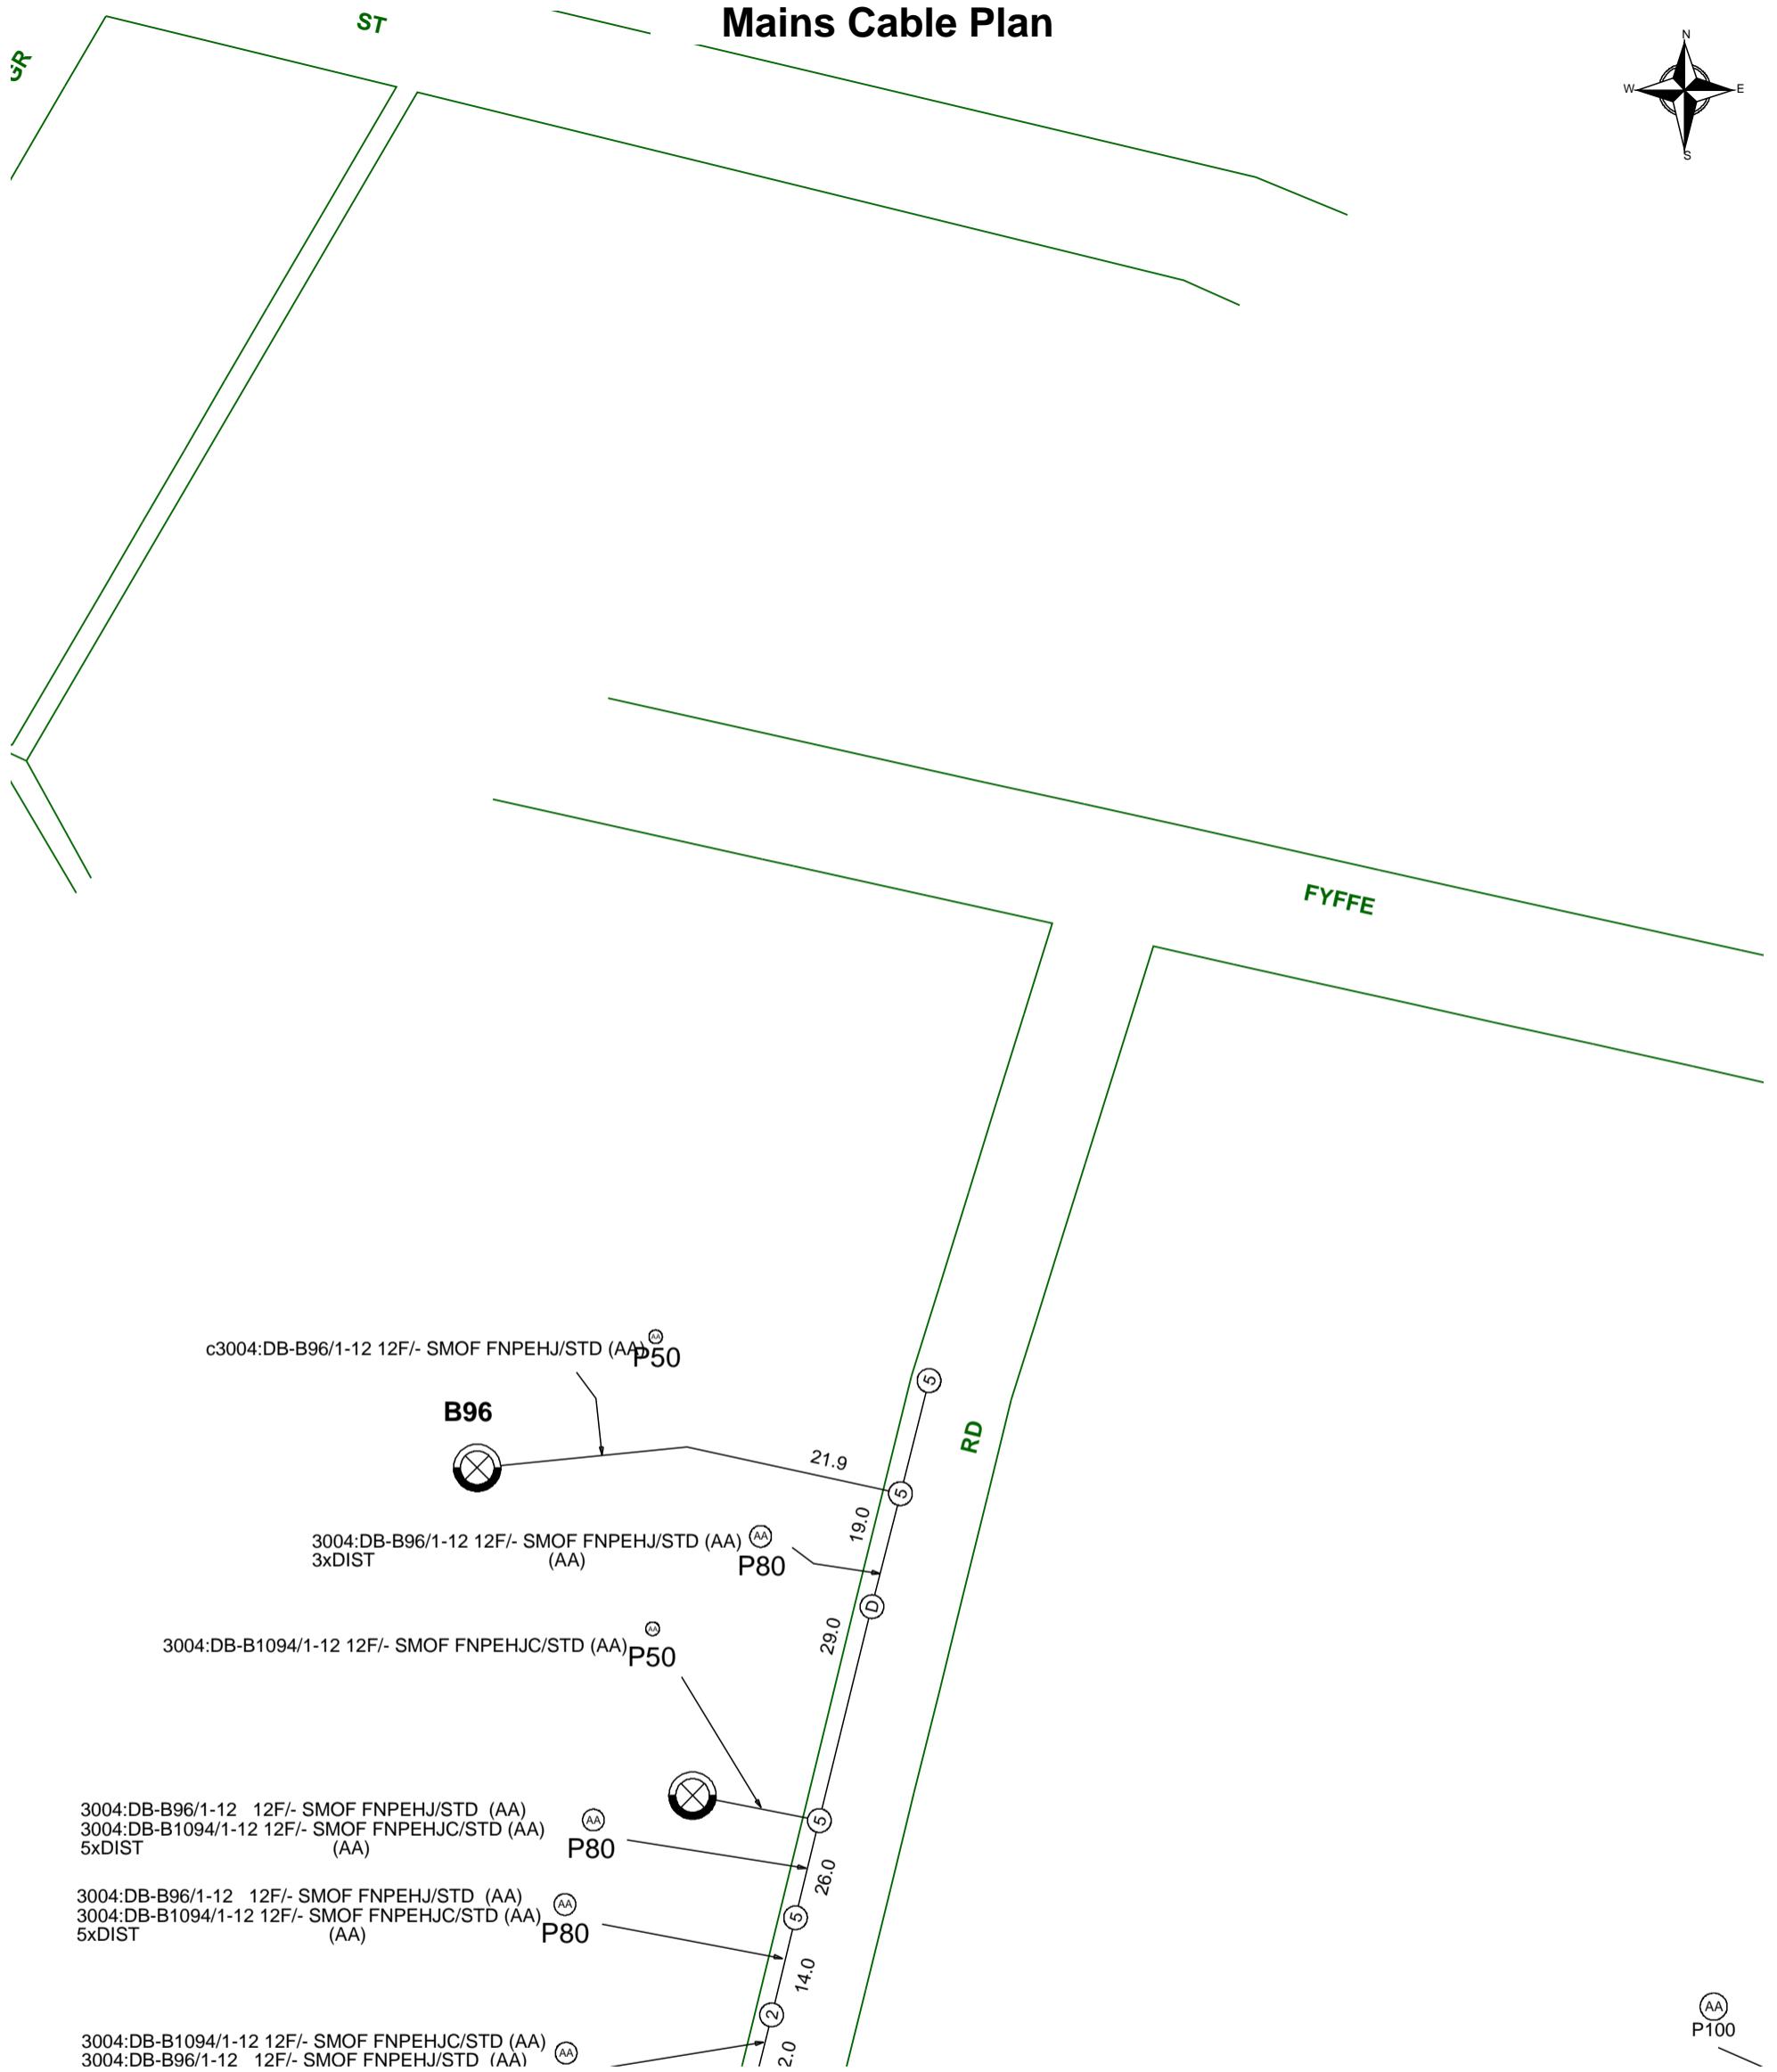

 <p>Report Damage: https://service.telstra.com.au/customer/general/forms/report-damage-to-telstra-equipment Ph - 13 22 03 Email - Telstra.Plans@team.telstra.com Planned Services - ph 1800 653 935 (AEST bus hrs only) General Enquiries</p> <p>TELSTRA LIMITED A.C.N. 086 174 781</p> <p>Generated On 05/06/2024 12:35:26</p>	<p>Sequence Number: 240175239</p> <p>CAUTION: Fibre optic and/ or major network present in plot area. Please read the Duty of Care and contact Telstra Plan Services should you require any assistance.</p>
---	--

WARNING
 Telstra plans and location information conform to Quality Level "D" of the Australian Standard AS 5488-Classification of Subsurface Utility Information.
 As such, Telstra supplied location information is indicative only. Spatial accuracy is not applicable to Quality Level D.
 Refer to AS 5488 for further details. The exact position of Telstra assets can only be validated by physically exposing it.
 Telstra does not warrant or hold out that its plans are accurate and accepts no responsibility for any inaccuracy.
 Further on site investigation is required to validate the exact location of Telstra plant prior to commencing construction work.
 A Certified Locating Organisation is an essential part of the process to validate the exact location of Telstra assets and to ensure the asset is protected during construction works.

See the Steps- Telstra Duty of Care that was provided in the email response.

Darebin City Council Received 5-06-2024

